
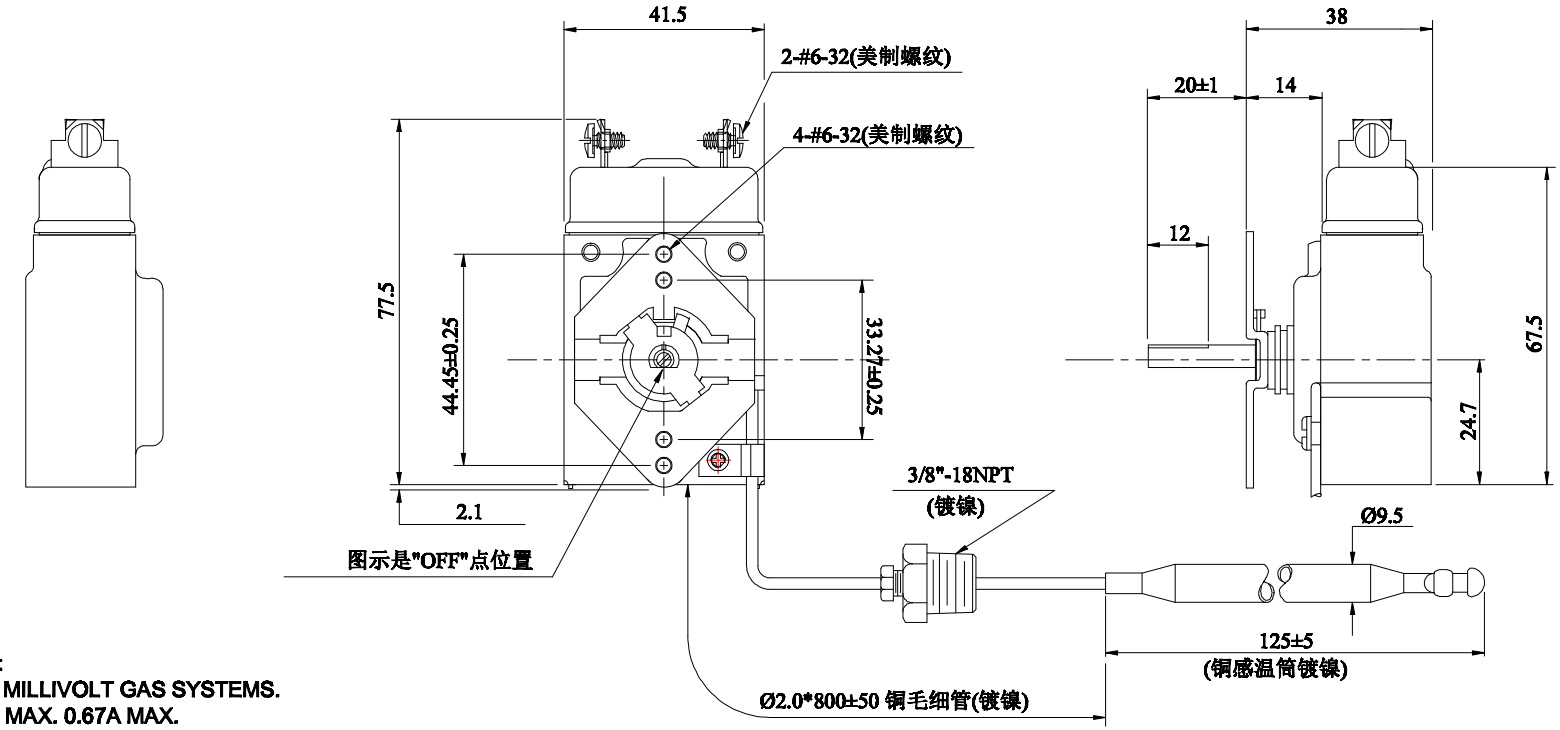




H点断开温度
204±8°C

SPECIFICATIONS:

1. FOR USE WITH MILLIVOLT GAS SYSTEMS.
2. RATING: 5 VDC MAX. 0.67A MAX.
3. A. CALIBRATION:
   OFF 179.4°/173.9° C WITH ADJ. STEM AT 255° ARC FROM OFF.
   MAX DIFFERENTIAL 4.5°C
   B. COLD CHECK:
   OFF SNAP 87° ARC FROM OFF, BULB AT R.T.
4. 310°±3° ARC DIAL TRAVEL.
5. TEMPERATURE RANGE. OFF TO 93°C TO 204°C.
6. DIAL SPREAD 1.95° ARC PER °C.
7. CAPILLARY LENGTH IN INCHES IS LAST DASH NO. OF INVENSYS PART NO., CAPILLARY TOLERANCE:
8. ALL CALIBRATION CHECKS TO BE PERFORMED WITH BULB AND 152.5±25.4 OF CAPILLARY IN AN AGITATED LIQUID BATH CALIBRATION AND DIFFERENTIAL TO BE TEMPERATURE BATH CHANGE.
9. USE BRASS TERMINAL SCREWS ONLY, TIGHTEN TO .906-1.24 N-m.
10. ASSEMBLE PER P-11193.
11. AVOID 90° BENDING AT CAPILLARY TUBE WITHIN THIS SECTION, IN AREA WHERE 90° IS PERMISSIBLE, MINIMUM BEND RADIUS SHOULD BE. 250
12. RECOMMENDED THIGHTENING TORQUE FOR PACKING NUT INTO BUSHING TO EFFECT A SEAL IS 30 TO 40 IN-LBS.

标记 SIGN	更改文件号 ECN NO.	更改人 CHANGER	日期/DATE
设计/DESIGNED		日期/DATE	
审核/CHECKED		日期/DATE	
批准/APPROVED		日期/DATE	

零部件名称/PART NAME:

温控器
Thermostat

版次号 VERSION	数量 QTY	比例 SCALE
1		

第 张共 张
SHEET NO. OF

型号 MODEL NO.	
图号 DWG REF.	ARB-33-204Q
材料 MATERIAL	
颜色 COLOUR	

PROPERTY OF:
GUANZHOU V.CROWN THERMOSTAT LTD.