
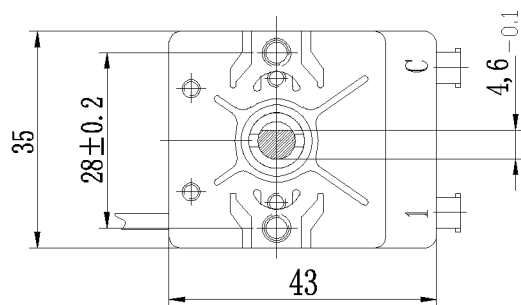


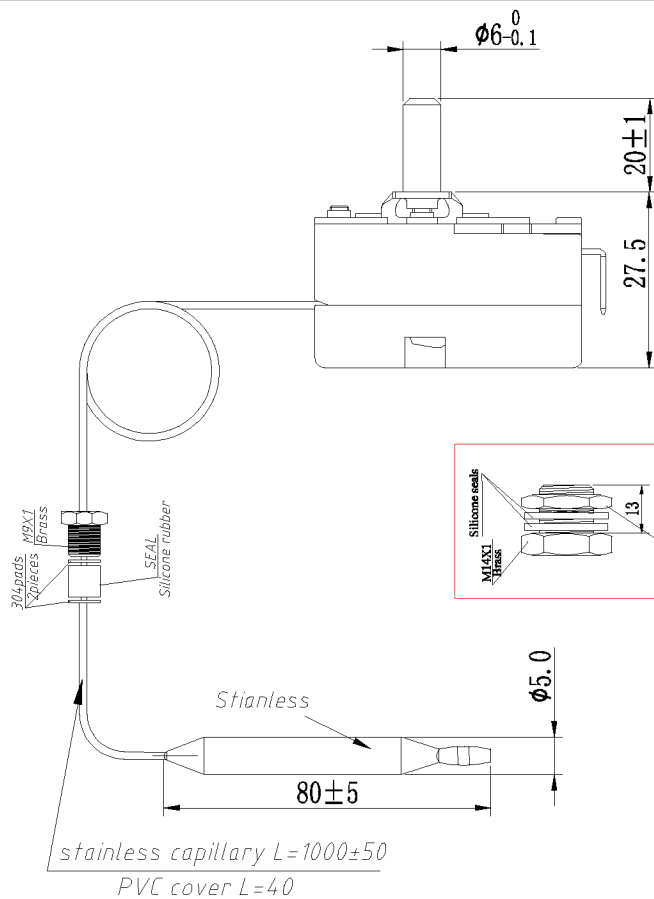

REMARK:

1. The operating temp. of the thermostat is $25^{\circ}\text{C} \pm 3^{\circ}\text{C}$ and capillary is immersed in testing liquid (50~80mm) for testing.

Different testing temp. is required if the testing parameter/condition is different.

2. Mounting screws must not touch thermostat body. Please use screws with proper length (5mm recommended).


3. ZERTIFIKAT NR. CERTIFICATE :TUV; CQC; VDE.

Electric Diagram:

S. P. S. T



Rotating Angle

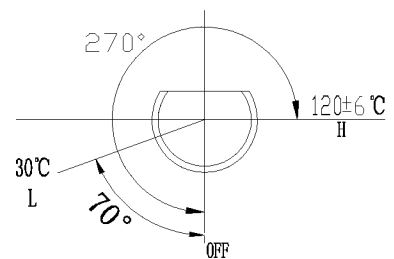

Technical Parameter

- H/off: $120 \pm 6^{\circ}\text{C}$
- L/off: (30°C)
- Breaking capacity: C-1 20A 250V~
- Minimum current: 200mA
- Dielectric Strength: AC 2000V 1min
- Insulation Resistance: $>100\text{M}\Omega$
- Temperature change speed: $<1.0^{\circ}\text{C/min}$
- Maximum temperature:
 - Around the Switch Body $T125^{\circ}\text{C}$
 - Around the Sensing Bulb 180°C
- Rotating Torque of Adjustment Shaft: $<0.2\text{Nm}$
- Life of Product: $>100,000$ Cycles

				零部件名称/PART NAME:			HENG THERM MODEL	
				温控器 Thermostat			HTR-C401	
标记 SIGN	更改文件号 ECN NO.	更改人 CHANGER	日期/DATE	版次号 VERSION	数量 QTY	比例 SCALE	颜色 COLOUR	
设计/DESIGNED		日期/DATE	2019-10-21	4				
审核/CHECKED		日期/DATE						
批准/APPROVED		日期/DATE		第 SHEET NO.	张共 OF	张		